



Picton Employment Lands Study Area

Bushfire Technical Study

Prepared for

Wollondilly Shire Council

16 November 2022 | Version 1.0



Project Name:	Employment Land Rezoning – Technical Study – Picton		
Prepared by:	David Lemcke & Lew Short		
Client Details:	Chandran Kizhakke Veetil Senior Strategic Planner - Growth Wollondilly Shire Council 62-64 Menangle St, Picton NSW 2571		
Project Address	Picton		
Name	Position	Contact No	Email
David Lemcke	Senior Planner & Bushfire Specialist	0439 220 464	David.lemcke@blackash.com.au
Version	Primary Author(s)	Description	Date Completed
0.2	David Lemcke	Draft final	16 November 2022
1.0	Lew Short	Draft final for client	16 November 2022



David Lemcke | Senior Planner & Bushfire Specialist

Blackash Bushfire Consulting

B.A., Grad. Dip. Urban & Regional Planning; Master of Environmental Planning;
Adv. Dip. Of Public Safety (Emergency Management); Dip. Management



Lew Short | Principal

BlackAsh Bushfire Consulting

B.A., Grad. Dip. (Design for Bushfires), Grad. Cert. of Management (Macq), Grad. Cert. (Applied Management). Fire Protection Association of Australia BPAD Level 3 BPD-PA 16373


Disclaimer

Blackash Bushfire Pty Ltd has prepared this document in good faith based on the information provided to it and has endeavoured to ensure that the information in this document is correct. However, many factors outside the current knowledge or control of Blackash affect the recipient's needs and project plans. Blackash does not warrant or represent that the document is free from error or omissions and does not accept liability for any errors or omissions. The scope of services was defined in consultation with the client by time and budgetary constraints imposed by the client and the availability of reports and other data on the subject area. Changes to available information, legislation and schedules are made on an on-going basis and readers should obtain up-to-date information. To the fullest extent possible Blackash expressly excludes any express or implied warranty as to condition, fitness, merchantability or suitability of this document and limits its liability for direct or consequential loss at the option of Blackash to re-supply the document or the cost of correcting the document. In no event shall responses to questions or any other information in this document be deemed to be incorporated into any legally binding agreement without the express written consent of an officer of Blackash. The information in this document is proprietary, confidential and an unpublished work and is provided upon the recipient's promise to keep such information confidential and for the sole purpose of the recipient evaluating products / services provided by Blackash. In no event may this information be supplied to third parties without written consent from Blackash.

Contents

1. Abbreviations	4
2. Glossary	5
3. Property, Proposal & Summary	5
4. Introduction	6
5. Site Characteristics and Zoning	9
6. Strategic planning for bushfires	12
7. Bushfire Risk Management Plan	14
8. Planning for Bushfire Protection Requirements	18
8.1. Bushfire Protection Measures	19
8.2. PBP Chapter 8 – Other Development	20
9. Bushfire Threat Assessment	21
9.1. Methodology	21
9.2. Bushfire Hazard	21
9.3. Fire weather	21
9.4. Bushfire Prone Land	22
9.5. Vegetation	25
9.6. Slopes influencing bushfire	26
9.7. Asset Protection Zones	28
9.8. Bushfire Attack Levels	30
9.9. Access	32
9.10. Water Supply & Utilities	32
10. Constraints	33
11. Opportunities	Error! Bookmark not defined.
12. Recommendations	Error! Bookmark not defined.
13. Conclusion	Error! Bookmark not defined.
Appendix 1 References	36
Appendix 2 Overview of bushfire attack mechanisms	37
Appendix 3 Asset Protection Zone Requirements	41

1. Abbreviations

APZ	Asset protection zone
AS2419	<i>Australian Standard – Fire hydrant installations</i>
AS3745	<i>Australian Standard – Planning for emergencies in facilities</i>
AS3959	<i>Australian Standard – Construction of buildings in bushfire-prone areas AS 3959:2018</i>
BAL	Bushfire Attack Level
NCC	<i>National Construction Code</i>
BSA	Bushfire safety authority
EP&A Act	<i>Environmental Planning & Assessment Act 1979</i>
EPA Reg	<i>Environmental Planning and Assessment Regulation 2000</i>
GTA	General terms of approval
PBP	<i>Planning for Bush Fire Protection 2019</i>
RF Act	<i>Rural Fires Act 1997</i>
RFS	NSW Rural Fire Service
RFR	<i>Rural Fires Regulation 2013</i>
SFPP	Special fire protection purpose

2. Glossary

AS3959	Australian Standard AS 3959 Construction of buildings in bushfire-prone areas, Standards Australia, 2018, that outlines construction standards applicable to residential developments in bush fire prone areas
Bushfire Prone Area	An area of land that can support a bushfire or is likely to be subject to bushfire attack.
Bush fire safety authority	An approval of the Commissioner of the RFS required for a subdivision for residential or rural residential purpose or for a special fire protection purpose listed under section 100B of the RF Act.
Infill Development	Refers to the development of land by the erection of or addition to a residential building (or buildings) which does not require the spatial extension of services including public roads, electricity or water and is within an existing allotment.
Short Fire Run	Small or narrow parcels of vegetation that are less likely to support fully developed bushfires are referred to as a short fire run (SFR).

3. Property, Proposal & Summary

Address:	Picton Employment Lands Study Area Henry St, Argyle St & Wonga Rd, Picton NSW 2571 Lot 10 DP 583245, Lot 2 DP 583247, Lot 141 DP 997490, Lot 1 DP 537245, Lot 15 DP 1105675, Lot 16 DP 979250, Lot 1 DP 207443, Lot 11 DP 3007, Lots 910 & 911 DP 1121899, and Lots 1 & 2 DP 570466.
Type of development:	Technical study to inform a Planning Proposal for employment lands
NCC Categorisation	N/A

4. Introduction

Wollondilly Shire Council (WSC) have commissioned Blackash Bushfire Consulting (Blackash) to prepare a Bushfire Technical Study as Stage 2 of the Employment Lands Rezoning Proposal Technical Study (study). The purpose of the study is to ascertain the suitability of selected lands for employment generating uses that enable new business opportunities and existing business expansion, and to facilitate longer term employment opportunities for Wollondilly. WSC have provided the study location as part of work already performed in the Wollondilly Employment Land Strategy. **Figures 1 & 2** show the study area location.

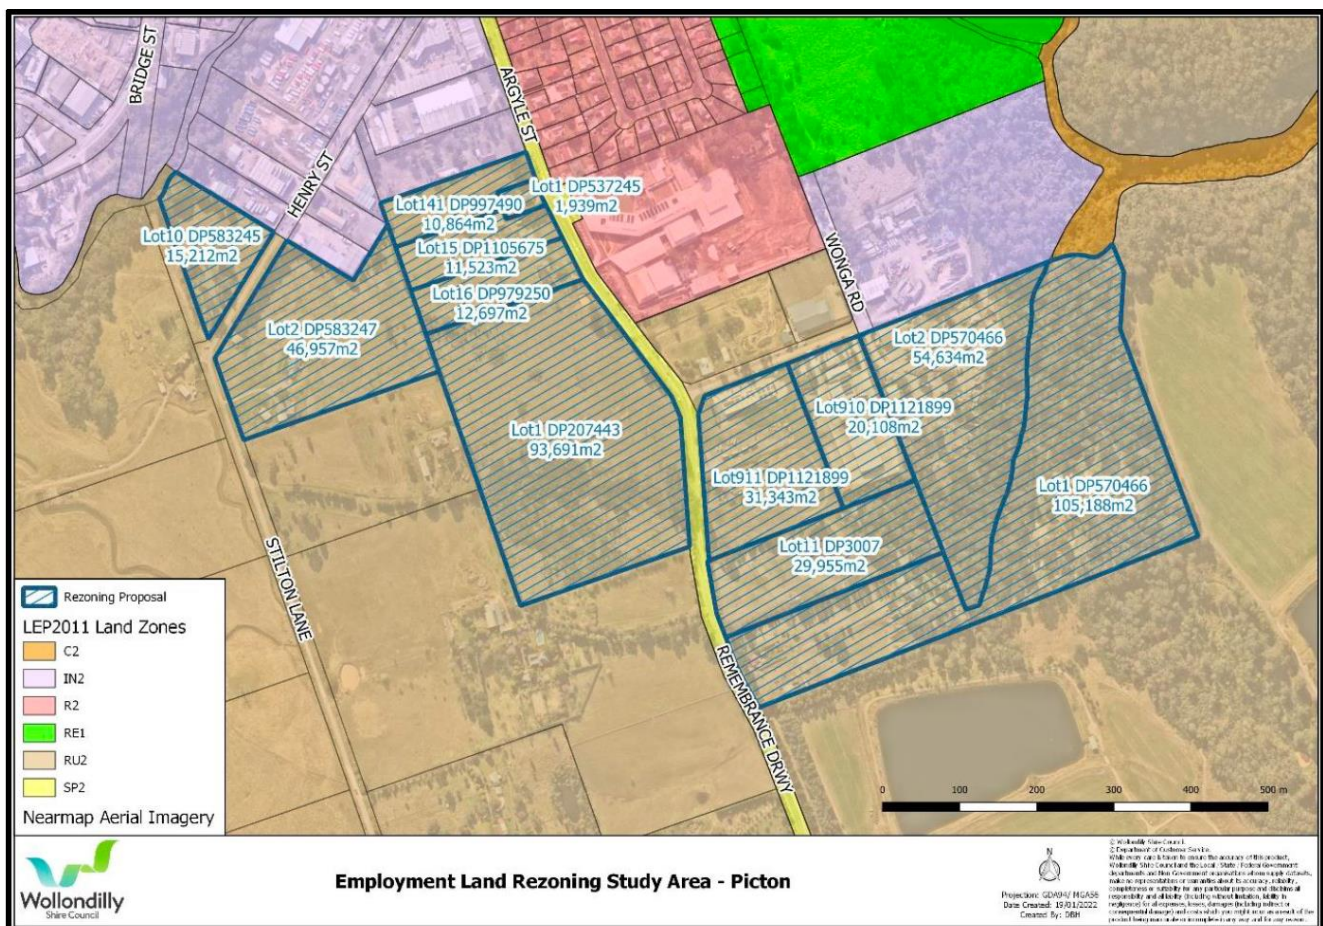


Figure 1: Picton study area and current zoning

A series of consultant led investigations have been undertaken to consider potential specific site constraints that may have a bearing on the final zone boundary including biodiversity, Aboriginal and historic heritage, geotechnical, contamination, and bushfire issues. Following receipt of the first stage consultant reports and in discussion with key consultants, WSC have determined proposed zone boundaries for more detailed consideration during this second stage of the process, based on detailed



Legend

Subject Land



Date: 22/04/2022

0 0.5 1

Kilometers

Coordinate System: GDA 1994 MGA Zone 56
Imagery: © Nearmap

Figure 2: Location

integration of the issues raised.

This report considers the bushfire impacts on the draft zone boundary lines, and provides high level advice on how to incorporate bushfire risk management into future employment lands to maximise bushfire protection and minimise impact on development yield.

The site, while large, has potential to be impacted by bush fire fronts from several directions. The proposal is located on land mapped by Council as being bushfire prone. As such, the proposal is subject to the requirements of Section 9.1 of the *Environmental Planning and Assessment Act 1979* (EP&A Act) which requires Council to consult with the Commissioner of the NSW RFS and to take into account any comments by the Commissioner. Direction 4.4, Planning for Bushfire Protection identifies matters for consideration for planning proposals that will affect, or are in proximity to land mapped as bushfire prone. This ties in with the new Strategic Planning requirements within PBP.

Bushfires are an intrinsic part of the NSW landscape. They are a natural hazard to which both rural and urban communities are exposed, and which are capable of inflicting tremendous consequences on communities and the sustainability of ecosystems. The consequences of bush fires can be significant in terms of lives lost, psychosocial impact, infrastructure and asset loss, reduction in business activity and the opportunity cost on the environment and other values to reduce risk and manage fuel.

The likelihood of bushfires, longer bushfire seasons and extreme bushfire behavior associated with intense weather occurring in NSW is predicted to rise due to climate change. As fire threat increases, disaster risk reduction and adaptation policies will play a critical role in reducing risks to people and their assets. Longer fire seasons will reduce the window of opportunity for planned burning. The importance of strategic planning is crucial to ensure that new development is able to meet the requirements of PBP.

A resilience-based approach is essential, focused on community wellbeing, liveability and sustainability through strategic planning and sound bushfire risk management. The NSW planning system recognises that not all areas should be developed, and that consideration is to be given to limiting or excluding incompatible development in bushfire affected areas commensurate with the level of risk. This assessment tests, in broad terms the bush fire constraints and opportunities of the subject site.

This bushfire assessment has been prepared by David Lemcke (Senior Planner & Bushfire Specialist) & Lew Short, Principal Blackash Bushfire Consulting (Level 3 FPAA BPAD-A Certified Practitioner No. BPD-PA-16373) who is recognised by the NSW Rural Fire Service (RFS) as qualified in bushfire risk assessment and has been accredited by the Fire Protection Association of Australia as a suitably qualified consultant

to undertake alternative solution proposals. A site inspection of the surrounding area was completed on 20 May 2022.

5. Site Characteristics and Zoning

The Picton Employment Lands study area is located at the southern side of the Picton urban area on Henry Street, Argyle Street (Remembrance Driveway) and Wonga Road, Picton NSW 2571, which are legally known as Lot 10 DP 583245, Lot 2 DP 583247, Lot 141 DP 997490, Lot 1 DP 537245, Lot 15 DP 1105675, Lot 16 DP 979250, Lot 1 DP 207443, Lot 11 DP 3007, Lots 910 & 911 DP 1121899, and Lots 1 & 2 DP 570466. The study area is approximately 43 hectares in size and is currently occupied by a mix of cleared and developed rural properties, existing businesses, and significant areas of native vegetation.

The study area is zoned under the Wollondilly Local Environmental Plan 2011 as RU2 – Rural Landscape. The urban area adjoining to the north of the study area is zoned for a mixture of residential and industrial uses, with a small part of the Pack Gully Creek riparian area zoned C2 - Environmental Conservation.

The site is located on the southern edge of the Picton township approximately 1 km south of the main shopping area and adjacent to existing large scale industrial, commercial and educational uses. The study area is well located with respect to local transport options with Argyle St/Old Hume Highway/Remembrance Driveway bisecting the study area and providing links to the north and south. Picton is a significant urban area and the administrative centre of the Wollondilly LGA with a listed population of 5282 people at the 2021 Census.

The study area is bordered to the east by bushland in the Redbank Creek riparian zone, rural grasslands areas to the south and significant cleared and maintained areas associated with Sydney Water sewerage treatment ponds, and to the east bushland in the Pack Gully Creek riparian area and leading to the wider Stonequarry Creek bushland.

Further to the west the development pattern has significant areas of urbanisation around Thirlmere and remains a predominantly mixed rural and rural residential landscape. On the western side of Thirlmere, approximately 6 km from the study area there are large areas of bushland being the Bargo State Conservation Area and Nattai National Park. These natural areas were heavily impacted by the Green Wattle Creek Fire in the 19/20 bushfire season. North of the site is the larger urban area of Picton. The wider surrounding area is the typical mixed rural and rural residential landscape characteristic of south western Sydney.



Figure 3: View north from Henry Street looking across the southwest corner of the site to Redbank Creek riparian zone and cleared areas beyond.



Figure 4: View northeast from Henry Street across the site – typical cleared rural setting extends to the south beyond the study area.



Figure 5: View north from the study to Picton from Remembrance Driveway.

The opportunities and constraints analysis identifies bushfire issues that should be considered and prioritised to reduce the risk of bushfire impact at the site and to meet the bushfire legislative provisions that the development proposal must respond to. The analysis can be used in the planning and design process where the information is weighed up to determine what is most pertinent to the future proposed zoning pattern.

Opportunities are those site characteristics that may encourage certain types of use or development. Constraints are those characteristics that might limit or restrict use. These will inform the ability of a site to be utilised having regard to bushfire issues, bushfire safety and compliance with NSW Rural Fire Service (RFS) document *Planning for Bushfire Protection 2019* (PBP).

6. Strategic planning for bushfires

All new development of Bushfire Prone Land (BPL) must comply with Land use planning is widely recognised as an important measure for limiting future vulnerabilities and losses in areas of new development and a critical element for building disaster resilient communities. The physical design and layout of communities and settlements are central to the many functions that sustain the social, economic and environmental support systems for the community. Land use planning provides the opportunity to manage new growth and residual risk resulting from new development by complying with legislation and standards, limiting or modifying the location of new development and influencing its layout. This can limit both the impacts of new development on natural systems, ecosystem services and hazards and the flow on impacts on the existing community, as well as limiting the impacts that natural hazards can have on new development and its users.

The *National Strategy for Disaster Resilience* (2011)¹ recognises that strategic planning is essential in creating safer and sustainable communities. In keeping with the policy and intent of government at all levels. Priority outcomes of Section 3.6 include:

- *All levels of decision making in land use planning and building control systems take into account information on risks to the social, built, economic and natural environments.*

Comprehensive consideration of bushfires and risks in the NSW planning system needs sound understanding of the landscape context and risks, as well as clarity on risk management principles and on the approach to strategic planning and development controls that will adequately mitigate identified risks. Where there are competing policy objectives, such as biodiversity conservation and fuel reduction, an agreed methodology or guidance is critical.

As such, planning decisions must be based on the best available evidence and rigorous merits-based assessment to ensure that new development is not exposed to unacceptable risk from bushfire. The framework provided within PBP provides the minimum requirements for new development within bushfire prone areas.

The importance of sound land use planning has been recognised in most significant bushfire inquiries, including Natural Disasters in Australia which noted that land use planning that considers natural hazard risks is the single most important mitigation measure in preventing future disaster losses in areas of new

¹ NSDR <https://www.homeaffairs.gov.au/emergency/files/national-strategy-disaster-resilience.pdf>

development, and that planning and development controls must be effective to ensure that inappropriate developments do not occur².

The final Bushfire Technical Study report focuses on disaster resilience which means planners, hazard leaders, emergency managers and other built environment professionals can contribute to:

- understanding and anticipating bushfire risks before they happen and developing more resilient land use and built form tailored to address bushfire risks, and
- minimising the increase in risks to people and disruptions to social and economic functions when a disaster strikes by ensuring compliance with state requirements for new development in Bushfire Prone Areas

The final report will demonstrate a balanced approach provided within the NSW framework for new development in Bush Fire Prone Areas. This recognises the need to protect human life and provide safe operating environment for fire and emergency services, while having due regard to environmental impacts, development potential of land and the need to cater for growing populations. The final report will include consideration of landscape scale risk using a decision support tool developed by Blackash.

Legislative Framework

The landuse planning framework as it relates to landuse planning and bushfire in NSW is embedded in the EP&A Act, the *Rural Fires Act 1997* (RF Act), *Rural Fires Regulation 2013* (RFR) which is articulated through PBP.

Strategic Planning Phase

The EP&A Act sets out the laws under which planning in NSW takes place. The main parts of the EP&A Act that relate to development assessment and approval are Part 3 (Planning Instruments) and Part 4 (Development Assessment).

EP&A Act Section 9.1 provides for the Planning Minister to direct councils to apply certain standards (detailed in the Direction) when preparing Planning Proposals for consideration. These Directions cover a range of practice areas and carry legislative weight.

² Ellis, S et al (2004) National Inquiry on Bushfire Mitigation and Management (p.92)

Planning Direction 4.4 Planning for Bush Fire Protection (Appendix 3) requires Council to consult with the Commissioner of the NSW Rural Fire Service when preparing a Planning Proposal and consider any comments made. Importantly, a Planning Proposal must:

- (a) have regard to Planning for Bush Fire Protection 2019
- (b) introduce controls that avoid placing inappropriate developments in hazardous areas; and
- (c) ensure that bushfire hazard reduction is not prohibited within the APZ.

Chapter 4 of PBP controls Strategic Planning, and details what must be included in a Strategic Bushfire Study (SBS). The SBS must be considered by Council, before any Planning Proposal to amend an LEP can be submitted to the Department of Planning and Environment (DPE). The SBS will be considered by DPE as part of the Gateway Determination. This determines whether the Planning Proposal should proceed further, or not, towards becoming an Environmental Planning Instrument (EPI).

7. Bushfire Risk Management Plan

The Wollondilly-Wingecarribee Bush Fire Management Committee (BFMC) has prepared the *Wollondilly-Wingecarribee Bush Fire Risk Management Plan 2017* (BFRMP). This is a strategic document that identifies community assets at risk, rates the relative risks and sets out a five-year program of coordinated multi-agency treatments to reduce the risk of bush fire to the assets. Treatments may include such things as mechanical hazard reduction (e.g., slashing, mowing), hazard reduction burning, grazing, community education and fire trail maintenance. The BRMP uses a state-wide methodology to risk assess all assets across the state consistently. The BRMP was last updated in 2017.

The Wollondilly-Wingecarribee BFMC covers 525,700 hectares. Land tenure and land use are critical for context, with 61.5% of the BFMC area being National Park and Sydney Catchment Authority land, 3.5 % Forest NSW, and only 31% of land privately owned and used for a variety of urban, rural residential and primary industry purposes.

The BRMP (p.9-10) outlines the following:

Climate and bush fire season

The typical climate in the Wollondilly/ Wingecarribee BFMC area is variable due to topographical and altitudinal differences. The low altitudinal areas north of the highlands experience a warm temperate climate with peak rainfall in the summer and autumn months.

The bush fire season in this area is generally from August to December but can extend to March depending on the onset of summer rainfall. South of the highlands is considerably higher in altitude and experience a relatively cool temperate climate with predominantly summer rainfall and the bush fire season generally runs from October to March.

Prevailing weather conditions associated with the bush fire season in the Wollondilly/ Wingecaribee BFMC area usually coincide with strong southwest to northwest winds and influenced by drought and rainfall conditions. There are also frequently dry lightning storms occurring during the bush fire season.

Population and demographic information

The population of the Wollondilly/ Wingecaribee BFMC area is approximately 90,000 people. The major population centres are Bundanoon, Moss Vale, Bowral, Mittagong, Picton, The Oaks, Tahmoor, and Warragamba. The following issues have been identified within the Wollondilly/ Wingecaribee BFMC area as potentially impacting on the ability of certain sections of the community to prepare themselves for bush fire:

- Residents of non-English background form a small percentage of the population and are generally dispersed throughout the LGAs.
- There are eighteen (18) villages and four (4) large towns that form part of an extensive urban interface with considerable bushland. This is compounded by a major state highway and the Sydney to Melbourne rail line traversing parallel to adjacent bushland interface.
- Tourism has a major effect on the local economy.
- Close proximity to major urban centres of southwest Sydney and the Illawarra exposes the area to many land owners commuting in and out of the highlands. A significant number of landowners also do not reside within the boundaries of the BFMC area.

History of bushfire frequency and ignition cause

The Wollondilly/ Wingecaribee BFMC area has on average 400 bush and grass fires per year, of which a number can be considered to be major fires.

A number of major fires have started in the inhabited areas of the BFMC and travelled in an easterly direction impacting on catchments. Most other major fires have ignited in the west associated with storms and have coincided with extensive dry periods coupled with hot westerly winds.

The main sources of ignition in the Wollondilly/ Wingecaribee BFMC area are:

- Lightning strikes associated with typical summer storm weather patterns

- *Arson including dumping of vehicles in bushland*
- *Pile burns escaping private residents' properties*

The site is located south of the main Picton township and has significant areas of bushland associated predominantly with riparian areas, and the wider area being predominantly grasslands associated with extensive grazing activity.

Major fires in the Sydney basin are driven by hot and dry winds from the west to northwest, with major flareups and damage associated with strong south to southwest wind changes. The potential for extreme bushfire weather driving large scale and intense bushfires into the local area is significant, however the fragmented nature of the bushland in the Picton area substantially reduces the risks in the study area, limiting intense fire to the vegetation corridors associated with riparian areas. The southerly exposure to significant grassland areas means that whilst grassfires can be fast moving and dangerous, they are also more effectively dealt with using good planning to provide setbacks between the hazard and development areas.

The location and configuration of the land means the site is unlikely to become isolated due to bushfire as it directly adjoins the Picton township. The location and existing vegetation lend itself to be heavily impacted by the most intense bushfires being driven by strong southerly winds. There is potential for the site to be impacted from three aspects with prolonged bushfire attack in the form of ember attack, smoke, radiant heat and direct flame contact.

BRMP references to the Planning Proposal site

The BRMP considers Human Settlement Assets at a broad scale of towns, suburbs, villages, or localities. The Planning Proposal site is adjoining the area identified as Wonga Road Commercial area - Economic Asset No. 351 (**Figure 6**). Broadly, the larger the number the lower the risk identified in the BRMP. The BRMP risk rates Asset No. 351 as **4 – Medium Risk**, arriving at the rating by considering the likelihood of bushfire spreading and impacting on assets in this group as “Likely” and the consequence as “Minor” (**Figure 7**). This relates to the presence of vegetation associated with the riparian areas, and recognises there is minimal wider landscape scale hazard.

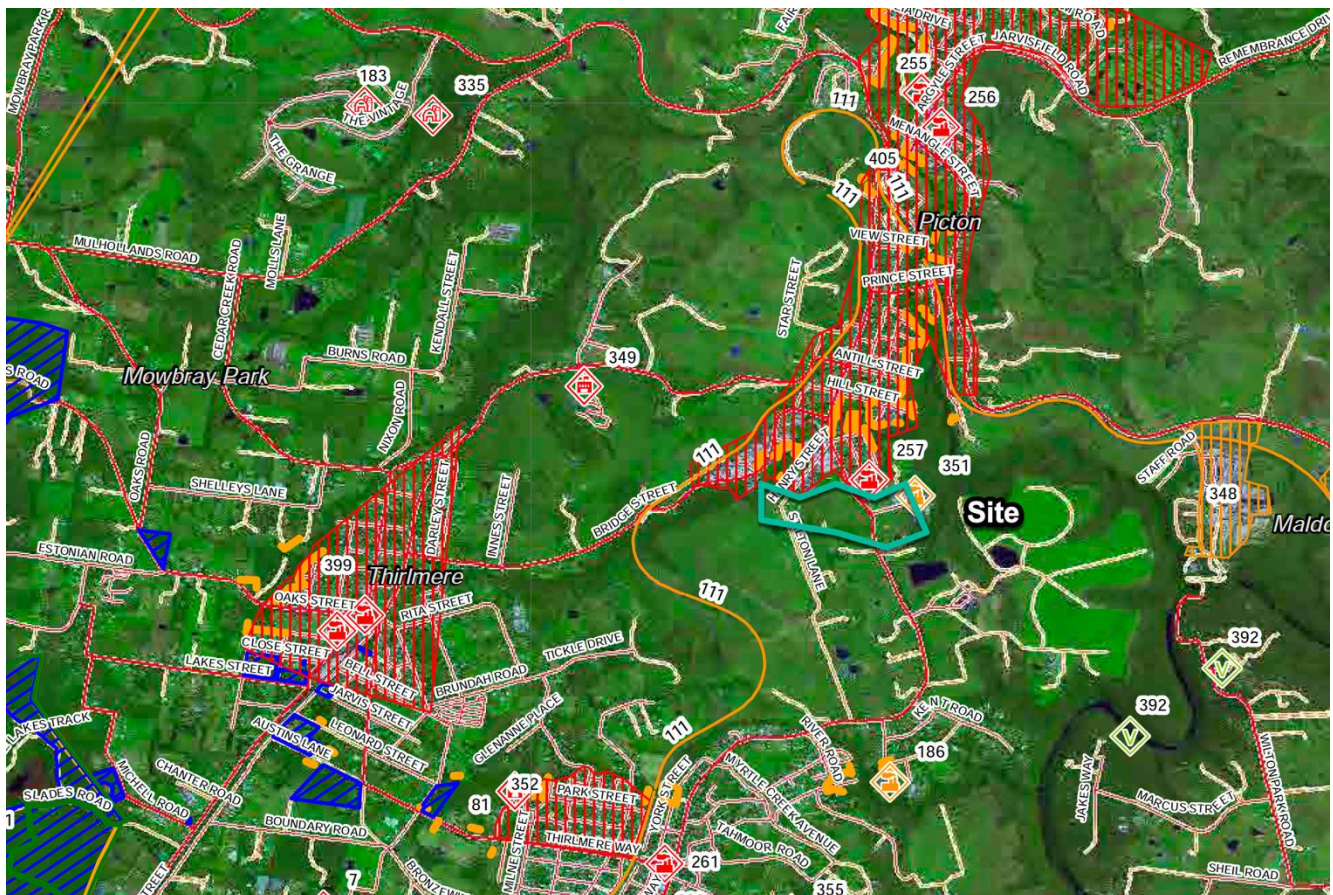


Figure 6: Extract from Wollondilly-Wingecaribee BRMP 2018-2023

Map Ref No.	Asset type	Asset sub type	Asset name	Asset Location	Display area	Likelihood	Consequence	Risk	Priority	Treatment number
351	Economic Human	Commercial	Wonga Rd	Picton	Tahmoor	Likely	Minor	Medium	4	297,309
352	Settlement	Residential	Tahmoor West	Tahmoor	Tahmoor	Unlikely	Major	Medium	4	293
353	Economic Human	Mines	Tahmoor Xstrata Mine	Tahmoor	Tahmoor	Unlikely	Major	Medium	4	294,160

Figure 7: Extract from Risk Register Wollondilly-Wingecaribee BRMP 2018-2023

8. Planning for Bushfire Protection Requirements

The Aim of and Objectives of PBP (p. 10) overall are:

All development on BFPL must satisfy the aim and objectives of Planning for Bush Fire Protection (PBP).

The aim of PBP is to provide for the protection of human life and minimise impacts on property from the threat of bush fire, while having due regard to development potential, site characteristics and protection of the environment.

The objectives are to:

- *afford buildings and their occupants protection from exposure to a bush fire;*
- *provide for a defendable space to be located around buildings;*
- *provide appropriate separation between a hazard and buildings which, in combination with other measures, prevent the likely fire spread to buildings;*
- *ensure that appropriate operational access and egress for emergency service personnel and occupants is available;*
- *provide for ongoing management and maintenance of Bushfire Protection Measures (BPM); and*
- *ensure that utility services are adequate to meet the needs of firefighters.*

PBP focuses very strongly on the protection of residential development and development with particularly vulnerable residents or occupants. Chapter 3 of PBP explains the different BPM and how they work in combination to achieve an acceptable risk managed outcome. Chapter 8 of PBP details the requirements for Other Development, which includes commercial and industrial development.

8.1. Bushfire Protection Measures

PBP promotes detailed site analysis and the application of a combination of BPM to achieve an acceptable outcome.

The BPM work in combination to provide a suite of measures that meet the Aim and Objectives of PBP, and requirements of Chapter 8 of PBP. The BPM are shown in **Figure 8**.

Appropriate combinations depend upon the type of development, and the specific geographic location and site circumstances. New commercial /industrial precincts have some advantages to manage these costs effectively and meet RFS requirements. These relate to typical access standards for large vehicles, plant and equipment, stormwater management, and setbacks for amenity and impact reduction on adjoining areas.

For example, Wollondilly Development Control Plan 2016 (WDCP) *Volume 7 – Industry and Infrastructure* specifies a number of standards that effectively require significant separation between future industrial/commercial development and adjoining land uses whether rural or conservation. Such setbacks when combined with perimeter roads designed for heavy vehicles provide the basic measures to support the intent of PBP to provide separation and good access.

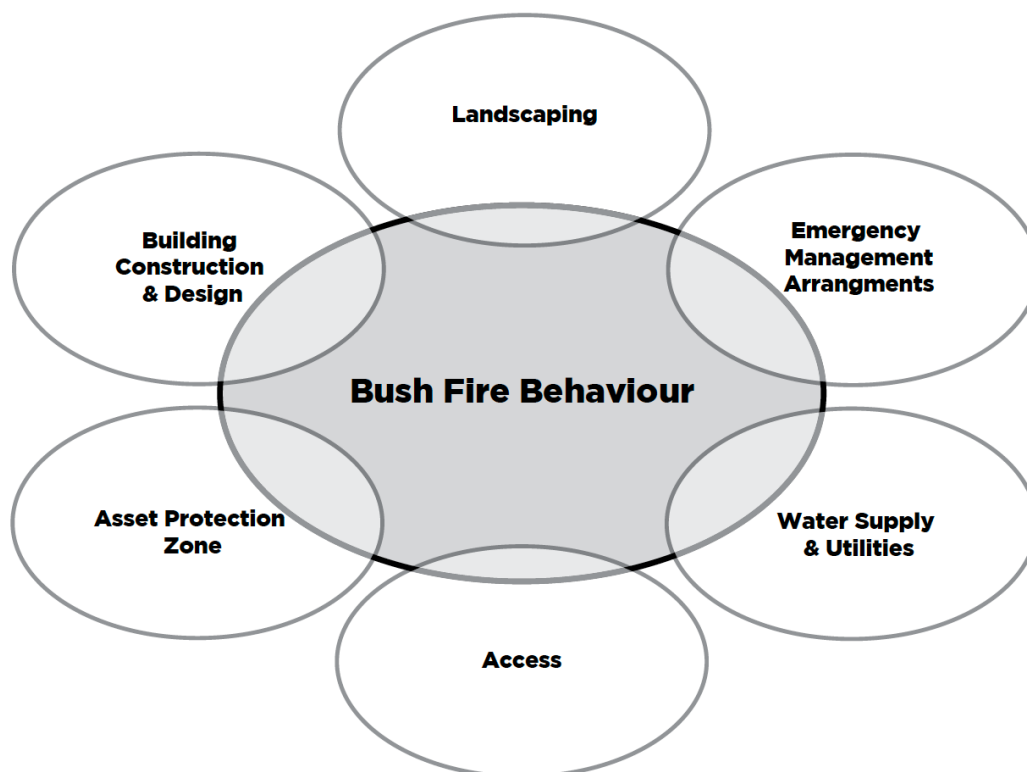


Figure 8: Bushfire Protection Measures in combination (PBP p.26)

8.2. PBP Chapter 8 – Other Development

The specific objectives of Chapter 8 and relevant sections are reproduced below as **Figure 9**:

<p>8.1 Introduction</p> <p>There are other developments where bush fire provisions or requirements need to be applied, that align with the unique features of the development type.</p> <p>In order to comply with PBP the following conditions must be met:</p> <ul style="list-style-type: none"> ➤ satisfy the aim and objectives of PBP outlined in Chapter 1; ➤ consider any issues listed for the specific purpose for the development set out in this chapter; and ➤ propose an appropriate combination of BPMs. <p>It is important to ensure that a defensible space is provided for the size and scale of the development. Proposed measures must operate in combination to minimise the impact of bush fire and ensure that access and services are adequate.</p>	<p>8.3.1 Buildings of Class 5 to 8 under the NCC</p> <p>Under the building classification system within the NCC, Class 5 to 8 buildings include offices, shops, factories, warehouses, public car parks and other commercial and industrial facilities.</p> <p>The NCC does not provide for any bush fire specific performance requirements for these particular classes of buildings. As such AS 3959 and the NASH Standard are not considered as a set of Deemed to Satisfy provisions, however compliance with AS 3959 and the NASH Standard must be considered when meeting the aims and objectives of PBP.</p> <p>Whilst bush fire is not captured in the NCC for Class 5-8 buildings, the following objectives will be applied in relation to access, water supply and services, and emergency and evacuation planning:</p> <ul style="list-style-type: none"> ➤ to provide safe access to/from the public road system for firefighters providing property protection during a bush fire and for occupant egress for evacuation; ➤ to provide suitable emergency and evacuation (and relocation) arrangements for occupants of the development; ➤ to provide adequate services of water for the protection of buildings during and after the passage of bush fire, and to locate gas and electricity so as not to contribute to the risk of fire to a building; and ➤ provide for the storage of hazardous materials away from the hazard wherever possible. <p>The general fire safety construction provisions of the NCC are taken as acceptable solutions however construction requirements for bush fire protection will need to be considered on a case-by-case basis.</p> <p>Where a mixed use development is proposed to have a SFPP component, an appropriate mix of BPMs should be applied consistent with the SFPP provisions in Chapter 6.</p>
<p>8.3.10 Commercial and industrial development</p> <p>Commercial and industrial development on BFPL is captured by EP&A Act s.4.14 where a manager's residence is included in the proposal. Where no residential component is included, commercial and industrial development is addressed through the aim and objectives of PBP (see Chapter 1 of this document).</p> <p>A suitable package of BPMs should be proposed commensurate with the assessed level of risk to the development. The scale of the development and numbers of people likely to be occupying the building will be directly relevant to the BPMs proposed.</p> <p>The provisions within Chapter 7 of this document should be used as a base for the development of a package of measures. Each development will be assessed on its own individual merits.</p>	

Figure 9: Extract of relevant sections from PBP Chapter 8 - Other Development

The overall objectives of PBP and the specific objectives identified in Chapter 8 for commercial/industrial development focus attention on separation of development from the hazard; access; emergency management arrangements; and provision of suitable services to assist bushfire management. Most of these will be dealt with at the individual development application stage based on development type.

9. Bushfire Threat Assessment

9.1. Methodology

PBP provides a methodology to determine the bushfire threat and commensurate size of any APZ that may be required to offset possible bushfire attack. These elements include the potential hazardous landscape that may affect the site and the effective slope within that hazardous vegetation. For new residential subdivision, APZ requirements are based on keeping radiant heat levels at new buildings below 29kW/m². Whilst no specific APZ standards are required for industrial/commercial development the residential standards provide a useful guide at Planning Proposal stage.

The following assessment is prepared in accordance with Section 100B of the RF Act, Clause 44 of the RF Reg and PBP. This assessment is based on the following resources:

- *Planning for Bush Fire Protection* (NSW RFS, 2019);
- Wollondilly Shire Council Bushfire Prone Land Map;
- Aerial mapping; and
- Detailed GIS and Site analysis.

The methodology used in this assessment is in accordance with PBP and is outlined in the following sections.

9.2. Bushfire Hazard

An assessment of the bushfire hazard is necessary to determine the application of bushfire protection measures such as APZ locations and dimensions and future building construction requirements in accordance with AS3959 (where applicable). The vegetation formations (bushfire fuels) and the topography (effective slope) combine to create the bushfire threat that may affect bushfire behaviour at the site, and which determine the planning and building responses of PBP.

9.3. Fire weather

The fire weather is dictated by PBP and assumes a credible worst-case scenario and an absence of any other mitigating factors relating to aspect or prevailing winds. The site has a Fire Danger Index (FDI) of 100 as the Wollondilly LGA is within the Illawarra / Shoalhaven Fire Weather District per PBP.

9.4. Bushfire Prone Land


Bushfire prone land (BPL) is land that has been identified by council, which can support a bushfire or is subject to bushfire attack. BPL maps are prepared by the local council and certified by the Commissioner of the RFS. The BPL maps provide a trigger for the development assessment provisions and consideration of sites that are bushfire prone.

The study area is predominantly on designated BPL for the purposes of Section 10.3 of the EPA Act. The BPL Map generally reflects the onground hazard and relation to tenure and zoning (see **Figure 10**), with significant areas of Hazard vegetation shown both on and adjoining the site.

9.5. Biodiversity Study Constraint impacts

The Biodiversity Study has examined the site and determined the baseline for areas that are potentially acceptable to be cleared and used for development. This has resulted in a reduction in total area that is available to be rezoned in comparison with the original study area. Through a collaborative process undertaken with WSC Planning staff and the Biodiversity consultants boundaries for these potential areas to be cleared have been established. The biodiversity constraints ultimately have determined the boundary of the area, and this has been influenced by the need for relatively regular shapes as the proposed perimeter roads will closely follow the boundary line.

This bushfire assessment has then been undertaken from the proposed zone boundary line, taking into account that the bushland on the conservation zoned land (outside the proposed development area) will ultimately be treated as bushfire prone land, forest vegetation in this case.

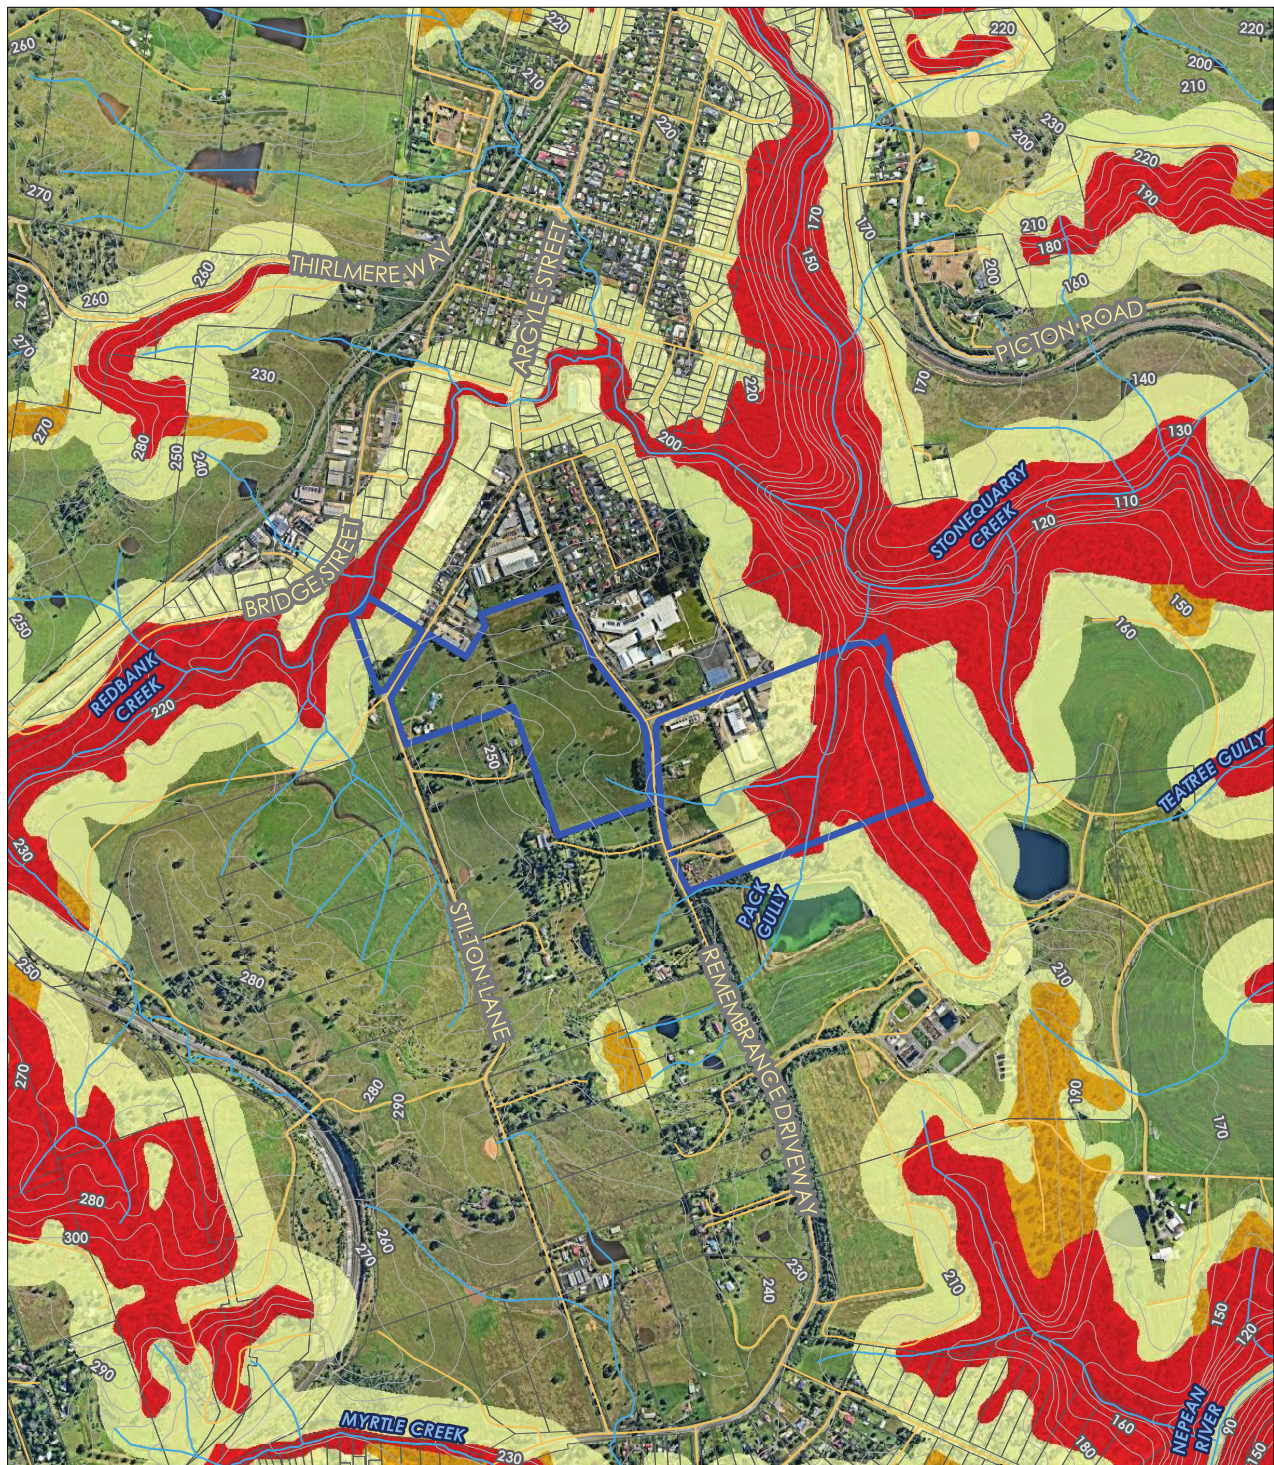

Legend

- Contour - 10m
- Watercourse
- Subject Land
- Cadastre
- Bushfire Prone Land**
 - Vegetation Buffer
 - Vegetation Category 1
 - Vegetation Category 2



Date: 22/04/2022

0 250 500
Meters

Coordinate System: GDA 1994 MGA Zone 56
Imagery: © Nearmap

Figure 10: Bushfire Prone Land Map extract

The site has Category 1 and Category 2 vegetation within it and is affected by surrounding Category 1 and Category 2 vegetation. The RFS revised *Guide for Bushfire Prone Land Mapping* (2015) introduced Category 3 vegetation for grassland areas. Councils map has not yet been updated to reflect these recent changes. Areas that are not directly adjacent to managed buildings would be categorised as Category 3 Bushfire Prone Land. A breakdown of the three designation is provided below (source RFS Bushfire Prone Mapping Guidelines p. 11)

Vegetation Category 1

Vegetation Category 1 is considered to be the highest risk for bush fire. It is represented as red on the bush fire prone land map and will be given a 100m buffer. This vegetation category has the highest combustibility and likelihood of forming fully developed fires including heavy ember production. Vegetation Category 1 consists of:

- *Areas of forest, woodlands, heaths (tall and short), forested wetlands and timber plantations.*

Vegetation Category 2

Vegetation Category 2 is considered to be a lower bush fire risk than Category 1 and Category 3 but higher than the excluded areas. It is represented as light orange on a bush fire prone land map and will be given a 30 metre buffer. This vegetation category has lower combustibility and/or limited potential fire size due to the vegetation area shape and size, land geography and management practices. Vegetation Category 2 consists of:

- *Rainforests.*
- *Lower risk vegetation parcels. These vegetation parcels represent a lower bush fire risk to surrounding development and consist of:*
- *Remnant vegetation;*

Land with ongoing land management practices that actively reduces bush fire risk. These areas must be subject to a plan of management or similar that demonstrates that the risk of bush fire is offset by strategies that reduce bush fire risk; AND include:

- *Discrete urban reserve/s;*
- *Parcels that are isolated from larger uninterrupted tracts of vegetation and known fire paths;*
- *Shapes and topographies which do not permit significant upslope fire runs towards development;*
- *Suitable access and adequate infrastructure to support suppression by firefighters;*

- *Vegetation that represents a lower likelihood of ignitions because the vegetation is surrounded by development in such a way that an ignition in any part of the vegetation has a higher likelihood of detection.*

Vegetation Category 3

Vegetation Category 3 is considered to be medium bush fire risk vegetation. It is higher in bush fire risk than category 2 (and the excluded areas) but lower than Category 1. It is represented as dark orange on a Bush Fire Prone Land map and will be given a 30 metre buffer. This category consists of:

- *Grasslands, freshwater wetlands, semi-arid woodlands, alpine complex and arid shrublands.*

9.6. Vegetation

Predominant Vegetation is classified by structure or formation using the system adopted by Keith (2004) and by the general description using PBP. Vegetation types give rise to radiant heat and fire behaviour characteristics. There are 7 vegetation formations (with sub-formations) identified in PBP.

The predominant vegetation has been determined over a distance of at least 140 metres in all directions from the proposed property boundary or building footprint on the site. Where a mix of vegetation types exist, the type providing the greater hazard is said to predominate. **Figure 11** shows the base assessment of the predominant vegetation as a mixture of Forest, Woodland, Grassland and managed land surrounding the site. There is an assumption that the entire site will be cleared for development until specific constraints are identified.

The amount of vegetation to be retained or managed within the study area influences the future and potential risk to development, occupants and emergency services. Retained vegetation within the site that is not managed can provide fuel source features for fire penetration within the site. Often, tensions exist between the retention of vegetation and ecological values with the need to mitigate bushfire risk and comply with PBP. This is noted as a particular concern given the riparian area of Pack Gully Creek.

The retention of vegetation within the site and access will need to be carefully weighed in the design process to minimise environmental impact while meeting the requirements of PBP. This will often require an iterative design process looking at a number of constraints for the site. It is likely, that the bushfire requirements at the site will clash with broader environmental outcomes that will need to be considered and balanced.

9.7. Slopes influencing bushfire

The 'effective slope' influencing fire behaviour approaching the sites has been assessed in accordance with the methodology specified within PBP. This is conducted by measuring the worst-case scenario slope where the vegetation occurs over a 100 m transect measured outwards from the development boundary or the existing/ proposed buildings.

The effective slopes for the site with the proposed subdivision layout are shown in **Figure 11**. These are typical of the wider undulating landscape cut through with riparian areas. Slopes range from upslope, to large areas of downslopes of less than 5 degrees, and some steeper areas around the riparian zones of Redbank Creek, Pack Gully Creek and Stonequarry Creek that are very steep and likely to create significant constraints to future development.

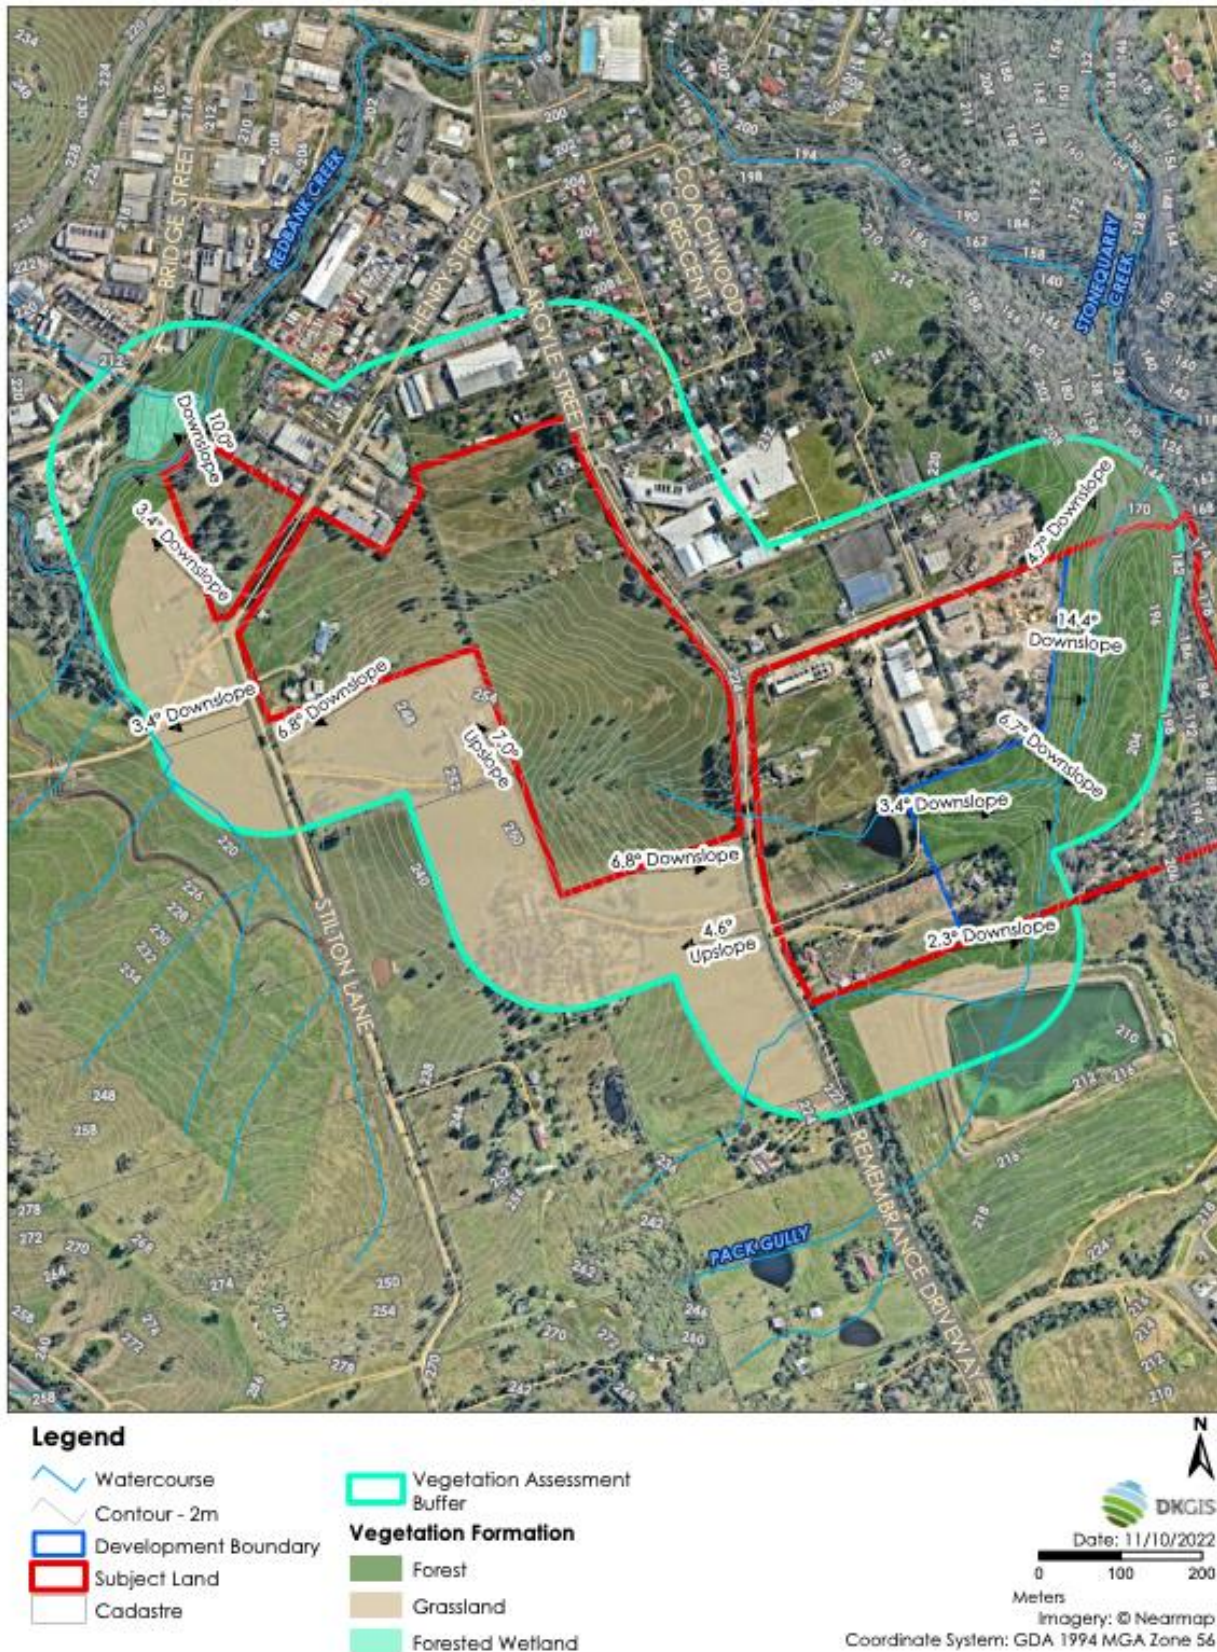


Figure 11: Slope and vegetation map - development boundary based on agreed biodiversity constraints

9.8. Asset Protection Zones

An APZ is a fuel-reduced area surrounding a built asset or structure which provides a buffer zone between a bushfire hazard and an asset. The APZ includes a defensible space within which firefighting operations can be carried out.

An APZ is land that has vegetation removed or maintained to a level that limits the spread and impact of bushfire. This may include:

- developed land (residential, commercial, or industrial),
- permanent roads, bike paths, parking areas, golf course fairways, playgrounds, and sports fields,
- vineyards, orchards, cultivated ornamental gardens and commercial nurseries, and
- gardens and lawns within curtilage of buildings.

For new industrial/commercial subdivision there are no specific APZ requirements. However, the assessment at Planning Proposal stage can be guided by the radiant heat levels required for residential subdivision which require building envelopes for new lots below 29kW/m². As noted in section 8.2 of this report, these standards are not required for industrial/commercial development, however they are used as a proxy for this consideration of the suitability of the study area. These APZ can be considered a worst-case scenario requirement for analysis at the planning stage to help determine ultimate suitability of various sites. **Figure 12** depicts the impact of APZ on the study area using the residential standards. **Figure 12** is based on the assumption that all vegetation within the site will be managed as an APZ or will be removed. Retained vegetation will need to be reviewed and APZs buffered from these areas. Areas of retained vegetation within the site may need additional buffers if there is potential for road "pinch points" to be created which are impacted and may be cut by fire.

APZ must be practical to maintain ongoing and not clash with other values such as koala corridors or protection of particular threatened species. In the context of industrial/commercial development areas this is likely to mean the future APZ will be wholly provided for within a perimeter road reserve and the front setbacks of future development lots. In practice, the outer edge of the future perimeter roads must be maintained by the roads authority, in this case WSC, with the expectation that the nature strip or verge will be maintained by future occupiers of the development lots.

Under S.63 (2) of the RF Act:

It is the duty of the owner or occupier of land to take the notified steps (if any) and any other practicable steps to prevent the occurrence of bush fires on, and to minimise the danger of the spread of bush fires on or from, that land.

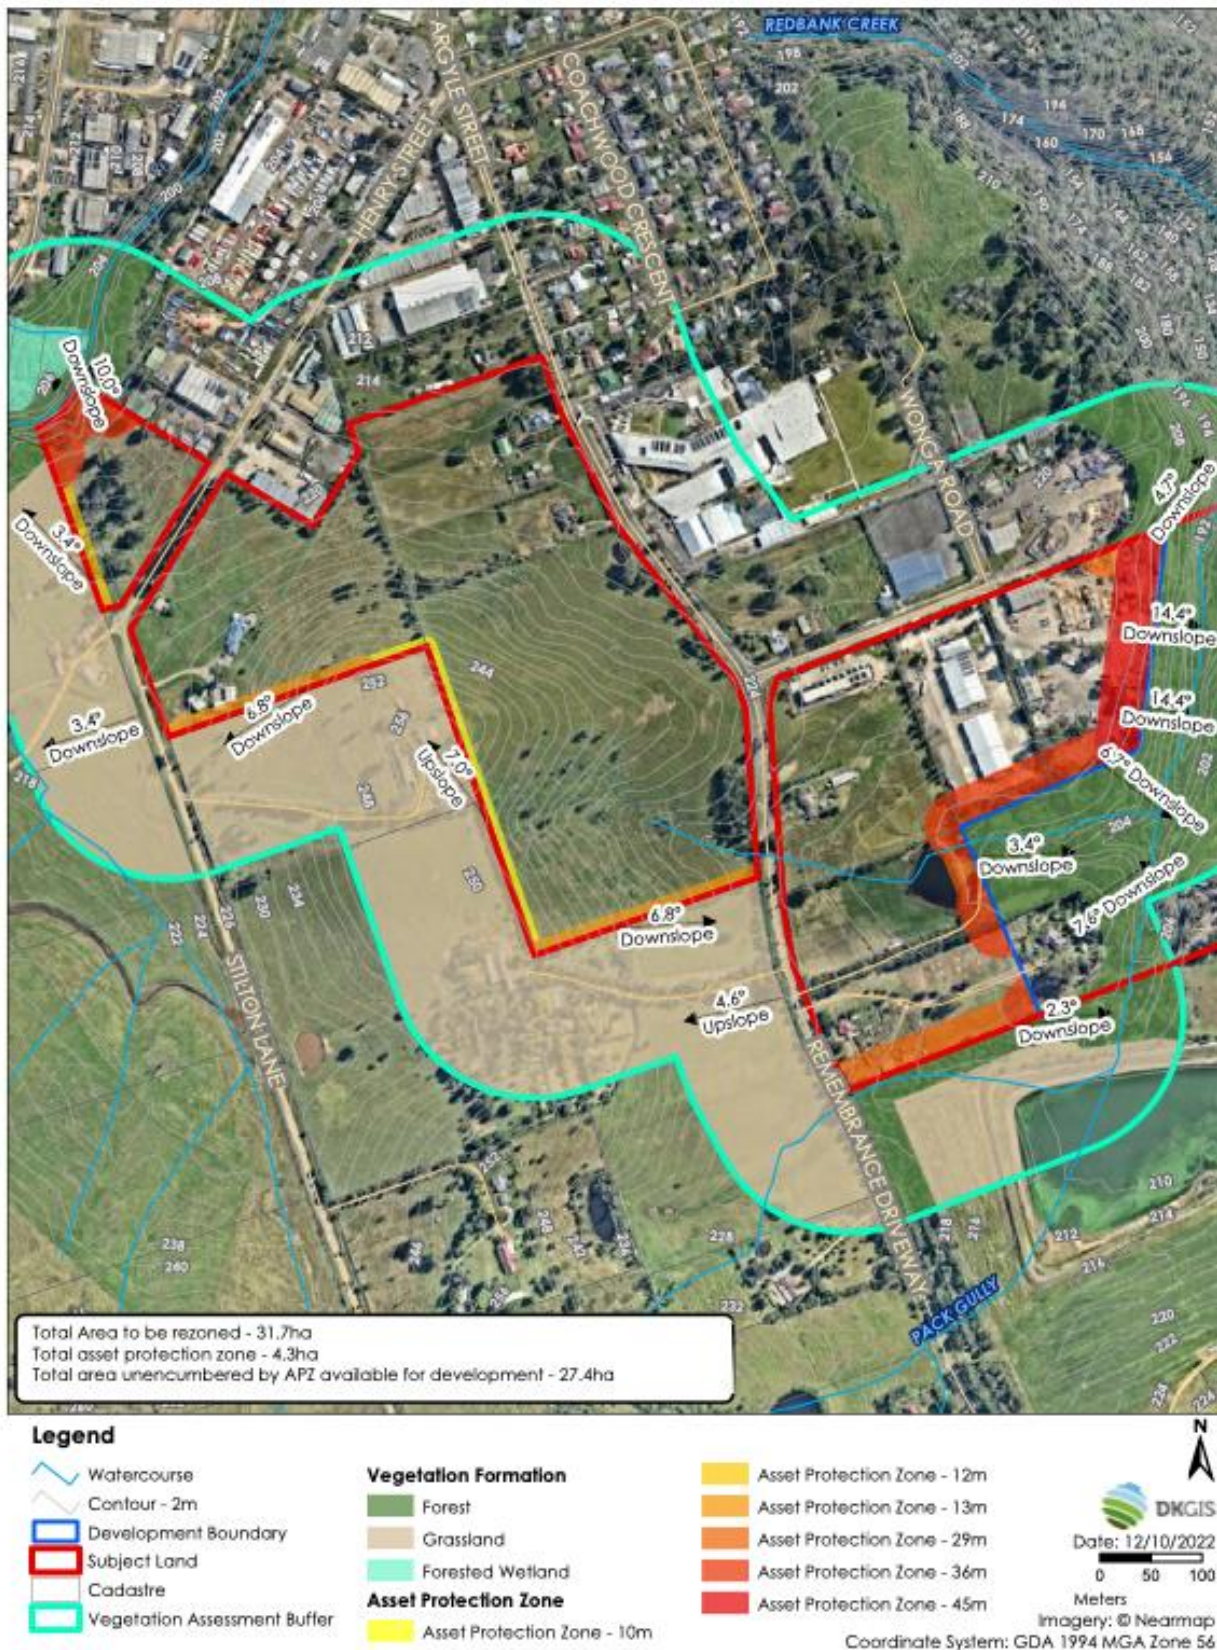


Figure 12: Asset Protection Zones - development boundary based on agreed biodiversity constraints

9.9. Bushfire Attack Levels

The Bushfire Attack Levels (BAL) is a means of measuring the ability of a building to withstand attack from bushfire. The form of bushfire attack and the severity will vary according to the conditions (FDI, vegetation, slope and setback) on the site.

The BAL assesses the severity of a building's potential exposure to ember attack, radiant heat and direct flame contact, using increments of radiant heat expressed in kilowatts per square metre, which is the basis for establishing the requirements for construction to improve protection of a building from potential attack by a bushfire, as defined in *Australian Standard AS 3959-2018 Construction of buildings in bushfire-prone areas* (AS 3959-2018).

The BAL ratings are used as the basis for establishing the requirements for construction to improve protection of a (proposed) building from potential bushfire attack. There are six BAL ratings in total: LOW, 12.5, 19, 29, 40 and FZ (see Appendix 2 for detail).

Figure 13 shows an indicative BAL assessment for the site based on the adjoining bushfire hazard to the development area.

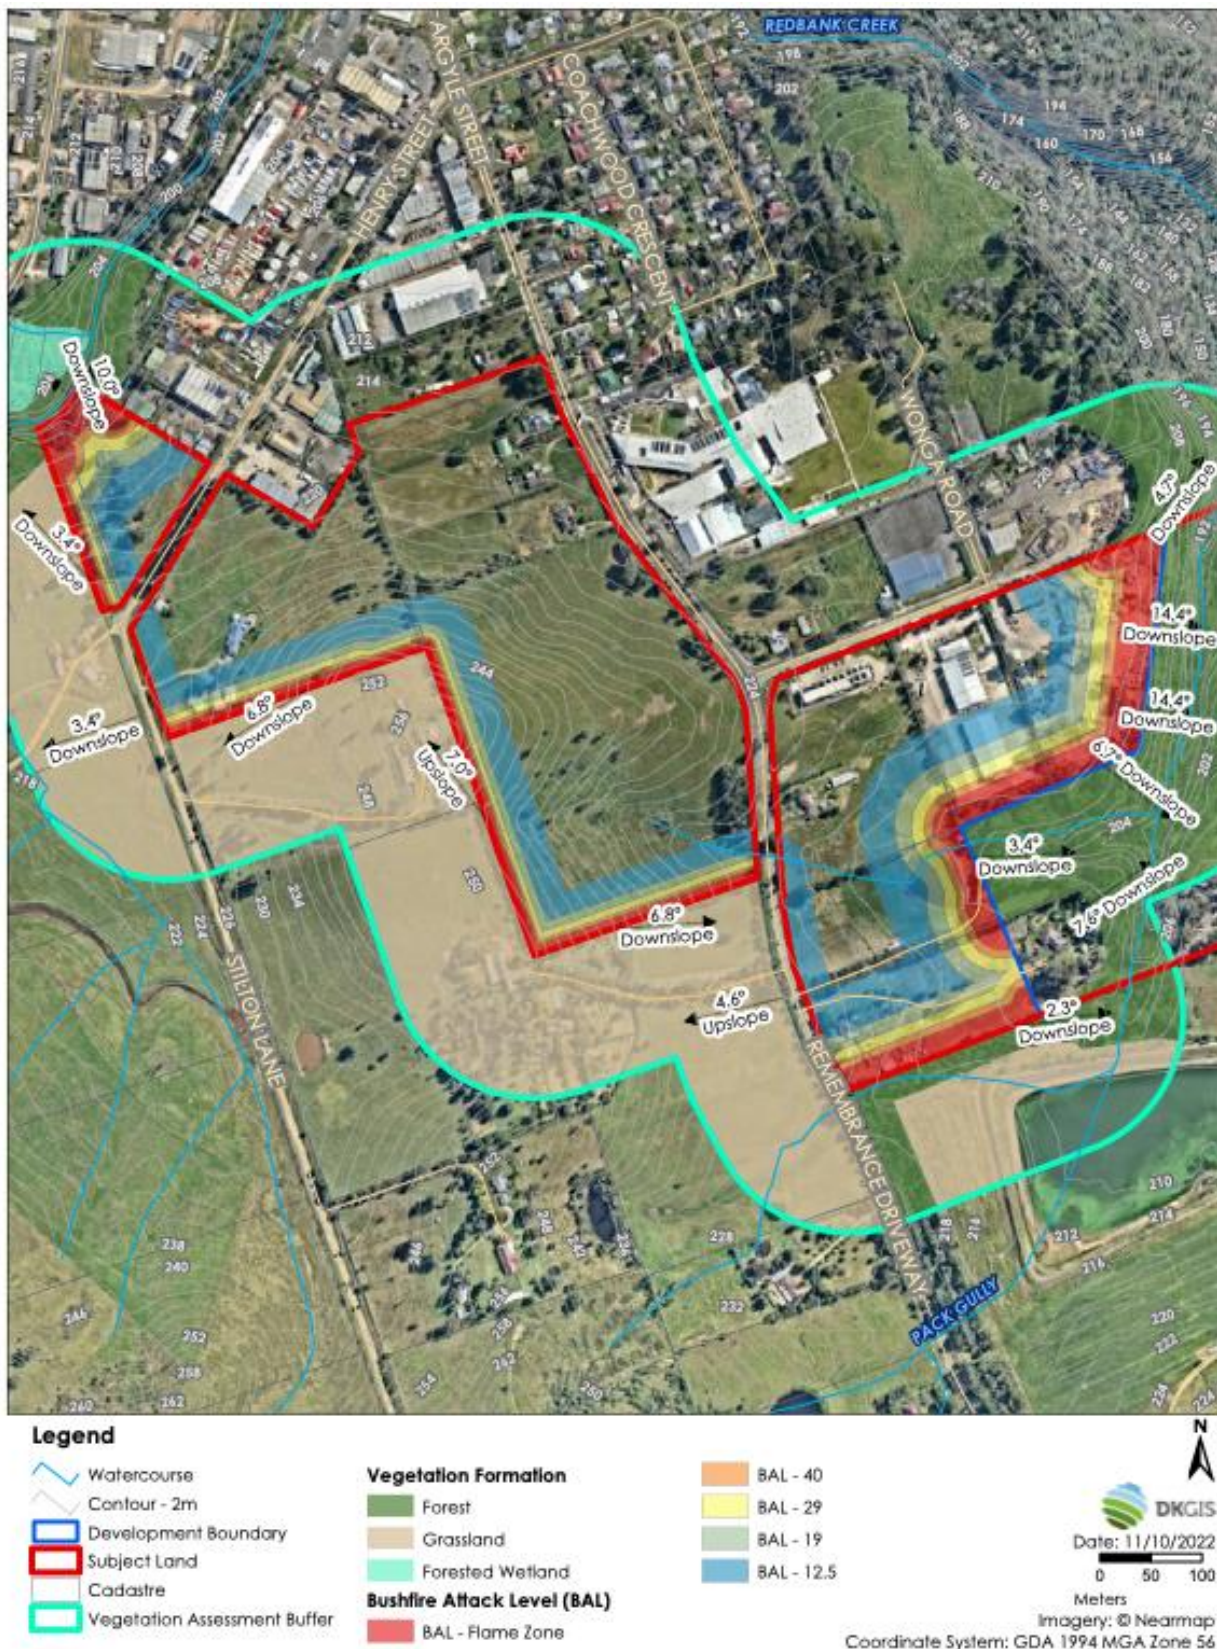


Figure 13: Indicative Bushfire Attack Level (BAL) map - development boundary based on agreed biodiversity constraints

9.10. Access

The objectives of PBP require all new development to:

Ensure that appropriate operational access and egress for emergency service personnel and occupants is available.

The study area is well connected to the wider local and regional road network and therefore the provision of a suitable internal road network and perimeter road to the bushfire hazard will be able to meet the objectives. The provision of roads suitable for industrial/commercial purposes will ensure all relevant road standards in PBP can be met.

This can be managed through the further stages of the rezoning process and subsequent development applications for subdivision and individual developments.

9.11. Water Supply & Utilities

The objectives of PBP require all new development to:

Ensure that utility services are adequate to meet the needs of firefighters.

Tables 5.3c and 5.3d of PBP (p. 47-48) detail the requirements for provision of water, electricity and gas services for residential development and provide performance criteria and acceptable solutions.

It is considered the provision of adequate water services and the location of electricity and gas supplies can be planned and managed to comply with PBP.

10. Conclusion

The bushfire risk to the site and future development is low, and these risks can be managed with suitable planning and design measures managed through the subdivision stage development application stage to comply with PBP. Development of the site extends Picton township into areas that have already been extensively cleared and managed. The provision of APZs would have minimal impact on biodiversity considerations.

Biodiversity constraints have been considered and the area available for future development has been reduced in comparison with the original study area. The agreed study area has been assessed using the methodology for new residential subdivision in bushfire prone areas, which provides a higher standard of protection than that required for industrial / commercial development.

This conservative approach demonstrates that a practical future lot layout can be achieved allowing for perimeter roads, the provision of suitable APZ and utilities and this will satisfy the key planning and design methods of Chapter 4 – Strategic Planning of PBP. The criteria for strategic suitability are outlined within PBP and are shown at **Figure 14**. Consideration of the utilisation of the ultimate development pattern can be made by future owners at the development application stage to comply with PBP.

The development of the study area in compliance with PBP would also provide a bushfire buffer to the existing Picton township, and some lesser assistance in managing the ongoing risk to the existing industrial zoned lands to the east and west sides of the development area on the riparian areas. These areas have not been subject to contemporary bushfire development controls and this additional buffer may be advantageous from a local bushfire management perspective.

Stormwater management facilities that may be required to service the development and protect surrounding areas should be carefully located to provide additional bushfire management benefits. The location of stormwater basins within APZ and adjacent to road “pinch points” provides a dual use for that land and can be designed to provide access to additional firefighting water supplies in addition to reticulated systems.

Should WSC seek to proceed with the planning proposal in the current form shown above, a formal Strategic Bushfire study will be required to be developed and submitted as part of the rezoning proposal.

This assessment demonstrates the site is capable of meeting these requirements and the employment lands rezoning planning proposal at Picton can proceed to the next stage with respect to bushfire management.

ISSUE	DETAIL	ASSESSMENT CONSIDERATIONS
Bush fire landscape assessment	A bush fire landscape assessment considers the likelihood of a bush fire, its potential severity and intensity and the potential impact on life and property in the context of the broader surrounding landscape.	<ul style="list-style-type: none"> ➤ The bush fire hazard in the surrounding area, including: <ul style="list-style-type: none"> ➤ Vegetation ➤ Topography ➤ Weather ➤ The potential fire behaviour that might be generated based on the above; ➤ Any history of bush fire in the area; ➤ Potential fire runs into the site and the intensity of such fire runs; and ➤ The difficulty in accessing and suppressing a fire, the continuity of bush fire hazards or the fragmentation of landscape fuels and the complexity of the associated terrain.
Land use assessment	The land use assessment will identify the most appropriate locations within the masterplan area or site layout for the proposed land uses.	<ul style="list-style-type: none"> ➤ The risk profile of different areas of the development layout based on the above landscape study; ➤ The proposed land use zones and permitted uses; ➤ The most appropriate siting of different land uses based on risk profiles within the site (i.e. not locating development on ridge tops, SFPP development to be located in lower risk areas of the site); and ➤ The impact of the siting of these uses on APZ provision.
Access and egress	A study of the existing and proposed road networks both within and external to the masterplan area or site layout.	<ul style="list-style-type: none"> ➤ The capacity for the proposed road network to deal with evacuating residents and responding emergency services, based on the existing and proposed community profile; ➤ The location of key access routes and direction of travel; and ➤ The potential for development to be isolated in the event of a bush fire.
Emergency services	An assessment of the future impact of new development on emergency services.	<ul style="list-style-type: none"> ➤ Consideration of the increase in demand for emergency services responding to a bush fire emergency including the need for new stations/brigades; and ➤ Impact on the ability of emergency services to carry out fire suppression in a bush fire emergency.
Infrastructure	An assessment of the issues associated with infrastructure and utilities.	<ul style="list-style-type: none"> ➤ The ability of the reticulated water system to deal with a major bush fire event in terms of pressures, flows, and spacing of hydrants; and ➤ Life safety issues associated with fire and proximity to high voltage power lines, natural gas supply lines etc.
Adjoining land	The impact of new development on adjoining landowners and their ability to undertake bush fire management.	<ul style="list-style-type: none"> ➤ Consideration of the implications of a change in land use on adjoining land including increased pressure on BPMs through the implementation of Bush Fire Management Plans.

Figure 14 Planning for Bushfire Protection Bushfire Strategic Study Requirements (source PBP p. 35)

11. Recommendations

The following recommendations are provided:

Recommendation 1 –

The agreed revised study area is considered suitable for a planning proposal to rezone for industrial / commercial uses and is likely to be supported by the NSW Rural Fire Service Commissioner.

Recommendation 2 –

A formal planning proposal to rezone the land must be accompanied by a Strategic Bushfire Study to satisfy the requirements of *Planning for Bushfire Protection 2019*.



David Lemcke | Senior Planner & Bushfire Specialist

Blackash Bushfire Consulting

B.A., Grad. Dip. Urban & Regional Planning; Master of Environmental Planning;
Adv. Dip. Of Public Safety (Emergency Management); Dip. Management



Lew Short | Principal

BlackAsh Bushfire Consulting

B.A., Grad. Dip. (Design for Bushfires); Grad. Cert. of Management (Macq); Grad. Cert. (Applied Management); Fire Protection Association of Australia BPAD Level 3 BPD-PA 16373



Appendix 1 References

NSW Rural Fire Service 2019. *Planning for Bushfire Protection: A guide for councils, planners, fire authorities and developers*. State of NSW.

Standards Australia. 2005. *Fire hydrant installations - System design, installation and commissioning*, AS 2419.1, Fourth edition 2005, SAI Global, Sydney

Standards Australia. 2008. *The storage and handling of LP Gas*, AS/NZS 1596:2008, Fourth edition 2008, SAI Global, Sydney.

Standards Australia. 2018. *Construction of buildings in bushfire-prone areas*, AS 3959-2018. SAI Global, Sydney.

Appendix 2 Overview of bushfire attack mechanisms

Bushfires have long remained a fundamental characteristic of the Australian bush landscape, and likewise Australians have long retained a strong affinity with bush environments. There remain a number of common factors which are associated with bushfire hazard and events and these include the incidence of fire weather, availability of fuel along with its type, structure and continuity or fragmentation, and the context of development at the bushland interface.

Bushfire attack refers to the various methods in which bushfire may impact upon life and property and principally encompass:

- Direct flame contact
- Ember attack
- Radiant heat flux
- Fire-driven wind
- Smoke

In the progression of a bushfire event, these methods interact either exclusively or in concert and are explained in the following section.

Direct flame contact

Direct flame attack refers to flame contact from the main fire front, where the flame which engulfs burning vegetation is one and the same as that which assumes contact with the building. It is the highest level of bushfire attack because of direct flame contact from the fire front in addition to heat flux and ember attack.

Ember attack

The convective forces of bushfire raise burning embers into the atmosphere on prevailing winds and deposit them to the ground ahead of the fire front. Typically, ember attack occurs approximately 30 minutes prior to the arrival of the fire front and continues during the impact of the fire front and for several hours afterwards, thus it is the longest lasting impact of bushfire attack.

Ember attack is attack by smoldering or flaming windborne debris that is capable of entering or accumulating around a building, and that may ignite the building or other combustible materials and debris.

In essence, building loss via ember attack relates largely to the vulnerabilities and peculiarities of each

building, its distance from hazardous vegetation and whether an occupant (or the like) is present to actively defend it. It is estimated by the Commonwealth Scientific and Industrial Research Organisation that approximately 80 to 90 per cent of buildings lost by bushfire are lost as a result of ember attack either in isolation or in combination with radiant heat impact.

Radiant heat flux

Exposure to radiant heat remains one of the leading causes of fatalities associated with bushfire events. Measured in kilowatts per square metre (kWm²), radiant heat is the heat energy released from the fire front which radiates to the surrounding environment, deteriorating rapidly over distance.

In terms of impact on buildings, radiant heat can pre-heat materials making them more susceptible to ignition or can cause non-piloted ignition of certain materials if the energy transmitted reaches a threshold level. Radiant heat can also damage building materials such as window glazing, allowing openings into a building through which embers may enter. Radiant heat impact is an especially important factor in building-to-building ignition.

In terms of radiant heat exposure for humans, it can cause pain to unprotected skin in milder situations or life threatening and fatal injury in higher exposure thresholds. The effects of radiant heat are shown in **Table 3**.

Table 1 The effects of radiant heat (NSWRFS 2006; Drysdale, 1999; CFA, 2012)

Radiant heat flux kW/m ²	Observed effect
1	Maximum for indefinite skin exposure
3	Hazardous conditions, firefighters expected to operate for a short period (10 minutes)
4.7	Extreme conditions, firefighters in protective clothing will feel pain after 60 seconds of exposure
6.4	Pain after 8 seconds of skin exposure
7	Likely to be fatal to unprotected person after exposure for several minutes
10	Critical conditions, firefighters not expected to operate in these conditions although they may be encountered. Considered to be life threatening in less than 60 seconds in protective equipment. Fabrics inside a building could ignite spontaneously with long exposure.
12.5 (BAL-12.5)	Volatiles from wood may be ignited by pilot after prolonged exposure. Standard float glass could fail during the passage of a bushfire.
16	Blistering of skin after 5 seconds
19 (BAL-19)	Screened float glass could fail during the passage of a bushfire.
29 (BAL-29)	Ignition of most timbers without piloted ignition (3 minutes of exposure) during the passage of a bushfire. Toughened glass could fail.
40+	Flame zone – exposure to direct flame contact from fire front.

Fire driven wind

The convective forces of bushfire typically result in strong to gale force fire-driven winds which in itself, can lead to building damage. The typical effects of fire driven wind include the conveyance of embers, damage from branches and debris hitting the building, as well as direct damage to vulnerable building components such as lifting roofs or roof materials and the damage / breakage of windows.

Smoke

Smoke emission remains a secondary effect of bushfire and is one which is typically not addressed by bushfire assessments. Irrespective, it is important to note the potentially severe impact of smoke emission on the human respiratory system. It can lead to difficulties in breathing, severe coughing, blurred or otherwise compromised vision, and can prove fatal. It is also important to note that toxic smoke can occur during bushfire, particularly where buildings or materials are ignited. With regard to evacuation, it can reduce visibility and create difficulties for particularly vulnerable persons.

Bushfire attack levels


The Bushfire Attack Levels (BAL) for the proposal site have been determined in accordance with PBP 2019 and the Australian Standards for *Construction of Buildings in Bushfire Prone Areas* (AS3959).

The BAL is a means of measuring the severity of a building or a site to potential exposure to ember attack, radiant heat and direct flame contact (see **Table 4**).

In the Building Code of Australia through AS3959, the BAL is used as the basis for establishing the requirements for construction to improve protection of building elements and to understand the radiant heat exposures for people in the open. The BAL output for the sites can be viewed with Table 3 for the effects of radiant heat. The BAL levels, the associated radiant heat flux and the predicted bushfire attack mechanisms from AS3959 are shown in **Table 4**. **Figure 17** shows the effects of the various forms of bushfire attack.

Table 2: Bushfire Attack Levels (source AS3959 p. 34)

Bushfire Attack Level	Radiant Heat Flux exposure	Description of predicted bushfire attack and levels of exposure
BAL - Low	NA	There is insufficient risk to warrant specific construction requirements
BAL – 12.5	<12.5kWm ²	Ember attack
BAL – 19	>12.5kWm ² - <19kWm ²	Increasing levels of ember attack and burning debris ignited by windborne embers together with increasing radiant heat flux
BAL – 29	>19kWm ² - <29kWm ²	Increasing levels of ember attack and burning debris ignited by windborne embers together with increasing radiant heat flux
BAL – 40	>29kWm ² - <40kWm ²	Increasing levels of ember attack and burning debris ignited by windborne embers together with increasing radiant heat flux with the increased likelihood of exposure to flames
BAL – Flame Zone	>40kWm ²	Direct exposure to flames from the fire front in addition to radiant heat flux and ember attack

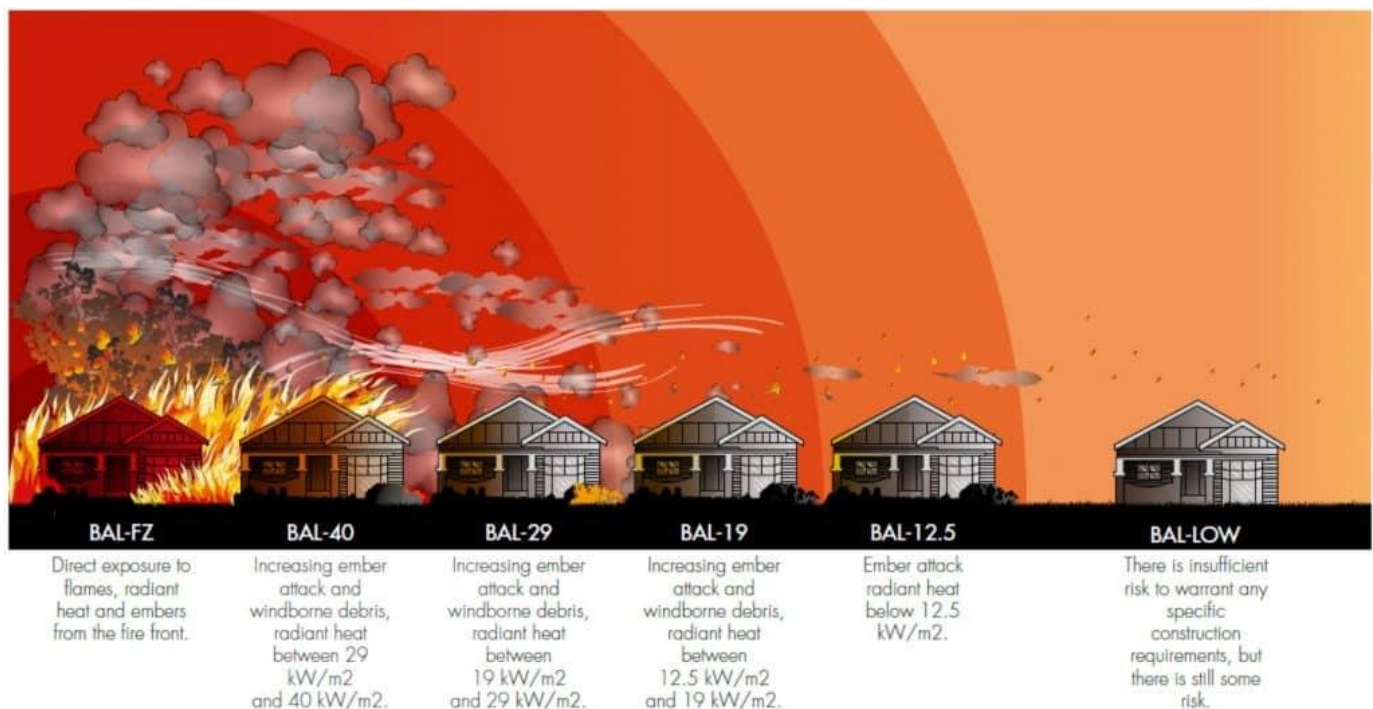
Figure 15: Forms of Bushfire Attack (source cfa.vic.gov.au)

Appendix 3 Asset Protection Zone Requirements

Source PBP 2019. P. 107

A4.1.1 Inner Protection Areas (IPAs)

The IPA is the area closest to the building and creates a fuel-managed area which can minimise the impact of direct flame contact and radiant heat on the development and act as a defensible space. Vegetation within the IPA should be kept to a minimum level. Litter fuels within the IPA should be kept below 1cm in height and be discontinuous.

In practical terms the IPA is typically the curtilage around the building, consisting of a mown lawn and well maintained gardens.

When establishing and maintaining an IPA the following requirements apply:

Trees

- tree canopy cover should be less than 15% at maturity;
- trees at maturity should not touch or overhang the building;
- lower limbs should be removed up to a height of 2m above the ground;
- tree canopies should be separated by 2 to 5m; and
- preference should be given to smooth barked and evergreen trees.

Shrubs

- create large discontinuities or gaps in the vegetation to slow down or break the progress of fire towards buildings should be provided;
- shrubs should not be located under trees;
- shrubs should not form more than 10% ground cover; and
- clumps of shrubs should be separated from exposed windows and doors by a distance of at least twice the height of the vegetation.

Grass

- grass should be kept mown (as a guide grass should be kept to no more than 100mm in height); and
- leaves and vegetation debris should be removed.

A4.1.2 Outer Protection Areas (OPAs)

An OPA is located between the IPA and the unmanaged vegetation. It is an area where there is maintenance of the understorey and some separation in the canopy. The reduction of fuel in this area aims to decrease the intensity of an approaching fire and restricts the potential for fire spread from crowns; reducing the level of direct flame, radiant heat and ember attack on the IPA.

Because of the nature of an OPA, they are only applicable in forest vegetation.

When establishing and maintaining an OPA the following requirements apply:

Trees

- tree canopy cover should be less than 30%; and
- canopies should be separated by 2 to 5m.

Shrubs

- shrubs should not form a continuous canopy; and
- shrubs should form no more than 20% of ground cover.

Grass

- grass should be kept mown to a height of less than 100mm; and
- leaf and other debris should be removed.

An APZ should be maintained in perpetuity to ensure ongoing protection from the impact of bush fires. Maintenance of the IPA and OPA as described above should be undertaken regularly, particularly in advance of the bush fire season.